


# Class 0 Summary Report

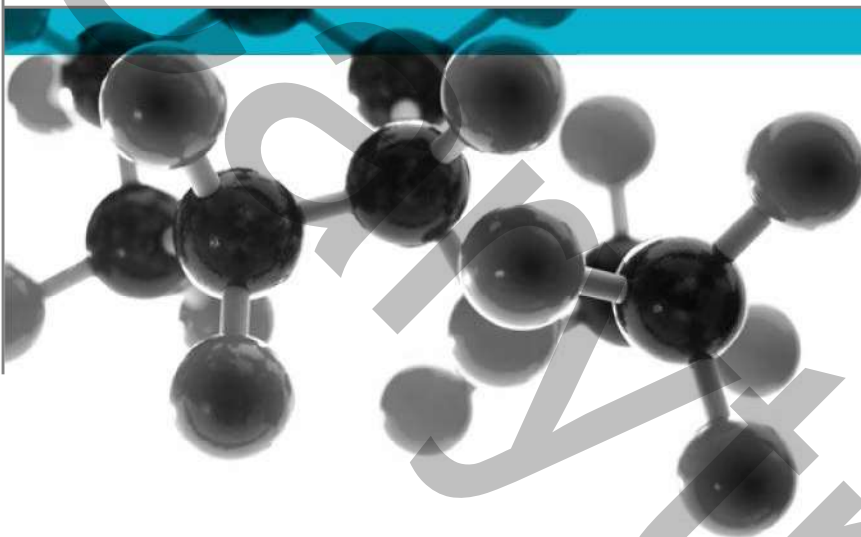

**Including Opinion Of Compliance With The Requirements For A Class 0 Surface As Defined In Paragraph A13(b) Of Approved Document B (Volumes 1 & 2), (2006 Edition) 'Fire Safety' To The Building Regulations 2000**

**Date:** 3<sup>rd</sup> April 2017

**Issue No.:** 1

Page 1

A Report To: Pyrotek Incorporated Pty Ltd.

Document Reference: 381636 & 381638

**Testing  
Advising  
Assuring**

## Executive Summary

**Objective** To assess the results of tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7:1997, obtained on specimens of the following product and to provide an opinion of compliance with the requirements for a Class 0 surface, as defined in Approved Document B to the Building Regulations 2000.


Generic Description	Product reference	Thickness	Weight per unit area
Laminated aluminium foil	"Pyrotek Laminating Foil"	0.02mm *	58.0g/m <sup>2</sup> *
<b>*Determined by Exova Warringtonfire</b>			
<b>Please see page 5 of this test report for the full description of the product tested</b>			

**Test Sponsor** Pyrotek Incorporated Pty Ltd., 147-149 Magowar Road, Girraween NSW 2145, Australia

**Opinion:** We consider the results of the tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7: 1997, demonstrate that the product, as tested, complies with the requirements for Class 0, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.


**Date of Test** 27<sup>th</sup> & 28<sup>th</sup> March 2017

## Signatories



---

Responsible Officer  
C. Meachin \*  
Technical Officer



---

Authorised  
B. Dean \*  
Technical Leader

\* For and on behalf of **Exova Warringtonfire**.

Report Issued: 3<sup>rd</sup> April 2017

This version of the report has been produced from a .pdf format electronic file that has been provided by **Exova Warringtonfire** to the sponsor of the report and must only be reproduced in full. Extracts or abridgements of reports must not be published without permission of **Exova Warringtonfire**.

<b>CONTENTS</b>	<b>PAGE NO.</b>
<b>EXECUTIVE SUMMARY</b> .....	<b>2</b>
<b>SIGNATORIES</b> .....	<b>2</b>
<b>TEST DETAILS</b> .....	<b>4</b>
<b>DESCRIPTION OF TEST SPECIMENS</b> .....	<b>5</b>
<b>CLASSIFICATION</b> .....	<b>6</b>
<b>REVISION HISTORY</b> .....	<b>7</b>

## Test Details

**Terms Of Reference** To assess the results of tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7:1997, obtained on specimens of a product and to provide an opinion of compliance with the requirements for a Class 0 surface, as defined in Approved Document B to the Building Regulations 2000.

**Introduction** Specimens of a product have been tested in accordance with the test methods specified in BS 476: Part 6: 1989+A1: 2009 'Method of test for fire propagation for products' and BS 476: Part 7: 1997 'Method of test to determine the classification of the surface spread of flame of products'. The results of the tests are fully reported in the **Exova Warringtonfire** test reports No's. 381636 and 381638.

This summary test report has been prepared at the request of the sponsor and relates the results of the tests to the requirements for a Class 0 surface of a material or composite product, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.

This summary should be read in conjunction with, and not accepted as a substitute for, the **Exova Warringtonfire** test reports No's. 381636 and 381638. Those test reports may include additional information which may be relevant to the assessment of the potential fire hazard of the product.

**Face subjected to tests** The specimens were mounted in the test positions such that the shiny face was exposed to the heating conditions of the tests.

**Results of test** The following results were obtained for the specimens, which were tested.

**BS 476: Part 6:  
1989+A1: 2009**

Fire propagation index, I	=	2.8
subindex, $i_1$	=	2.2
subindex, $i_2$	=	0.5
subindex, $i_3$	=	0.1

**BS 476: Part 7:  
1997** Class 1 surface spread of flame

The test results relate only to the behaviour of the test specimens of the product under the particular conditions of the test, they are not intended to be the sole criterion for assessing the potential hazard of the product in use.

## Description of Test Specimens

The description of the specimens given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

General description	Laminated foil
Generic type	Aluminium
Product reference	"Pyrotek Laminating Foil"
Composition details	<b>See Note 1 Below</b>
Name of manufacturer	<b>See Note 1 Below</b>
Thickness	0.02mm (determined by <b>Exova Warringtonfire</b> )
Weight per unit area	58.0g/m <sup>2</sup> (determined by <b>Exova Warringtonfire</b> )
Colour reference	"Silver"
Flame retardant details	<b>See Note 2 Below</b>
Brief description of manufacturing process	<b>See Note 1 Below</b>

**Note 1: The sponsor was unwilling to provide this information.**

**Note 2: The sponsor of the test has confirmed that no flame retardant additives were utilised in the production of the product.**

## Classification

---

### Opinion

We consider the results of the tests detailed above demonstrate that the product, as tested, complies with the requirements for Class 0, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.

### Validity of opinion

This opinion is based on the requirements of the Building Regulations at the date of this report. If the Building Regulations are revised or amended in any way subsequent to that date, care must be taken to ensure that this opinion is not invalidated by those revisions or amendments.

The opinion has been formulated on the assumption that the specimens are representative of the product in practice. **Exova Warringtonfire** was not involved in any sampling or selection procedures which would confirm this or in any audit testing which would provide confidence in the consistency of the product in the tests.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of **Exova Warringtonfire**.

## Revision History

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	